

DCP-CZM CONVENTIONAL ZONE MODULE



STANDARD FEATURES

- Provides an address point for a zone of up to 25 conventional smoke detectors
- Blinks green when polled. Latched on red (controlled by panel) when activated
- Device address can be programmed with a handheld programmer. Device address- ranges from 1 to 127
- Compatible with Class B and Class A wiring
- Auxiliary power source provides power for the zone of detectors
- Compatible with conventional detectors, SLR, SIJ, SLK, SLV, DCD, DFE and SIH series

SPECIFICATIONS	
Supply Voltage (S-SC)	25.3 ~ 39 VDC
Auxiliary Supply Voltage	18.8 ~ 27.2 VDC
Average Current Consumption (On S-SC Line)	670µA
2-Wire Detector Loop Current	1mA Max.
Standby Detector Load	
From Auxiliary Supply	60mA Max.
EOL Device	4.7K ohms Resistor
Max. Quantity Per Loop	127
Alarm Threshold Level	<1.5K ohms
Wiring Threshold Level	>2.5K ohms & <6K ohms
Open Circuit Threshold Level	>10K ohms
Max. 2-Wire Conventional Detector (Loop Resistance)	50 ohms (total wire length)
Dimensions	4.2"W x 4.7"H x 1.4"D
Operating Temperature	32°F (0°C) ~ 120°F (49°C)
Mounting	4" square electrical box
Relative Humidity	90% RH Non-Condensing

DESCRIPTION

The Hochiki Conventional Zone Module (DCP-CZM) is designed for use on an analog addressable Fire Alarm system. Up to 127 devices can be placed on a single SLC loop. The device address is uniquely stored on an onboard EEPROM. The module allows the panel to interface and monitor two-wire conventional detectors or pull stations. Each DCP-CZM transmits the status on one zone of devices (25 maximum per zone) back to the panel. It supervises the power supply as well as the entire zone of devices. Status conditions are reported as normal, open or alarm. All 2-wire smoke detectors must be UL listed as compatible to be interfaced with the DCP-CZM. The interrupt driven Digital Communication Protocol (DCP) combines maximum communication reliability and fast response to emergency conditions. The module has a single bi-colored LED to indicate device status. It fits into a standard 4" square or double gang electrical back box.

PRODUCT LISTINGS


<p>SIGNALING</p>  <p>UL LISTED S5694</p>	 <p>California State Fire Marshal 7300-0410:150</p>	 <p>FM APPROVED 3033215</p>
---	--	---

Specifications subject to change without notice.

Continued on back.

ENGINEERING SPECIFICATIONS

The contractor shall furnish and install where indicated on the plans, Conventional Zone Module (DCP-CZM). The modules shall be UL listed and compatible with the Hochiki America Analog Control Panel Protocol. The device address shall be electrically programmable and stored in EEPROM. A bi-colored LED shall indicate device status. The DCP-CZM shall be supplied with a plastic cover and shall be suitable for mounting to a 4" square or double gang electrical back box. The DCP-CZM shall provide a monitor LED that is visible from outside the cover plate.

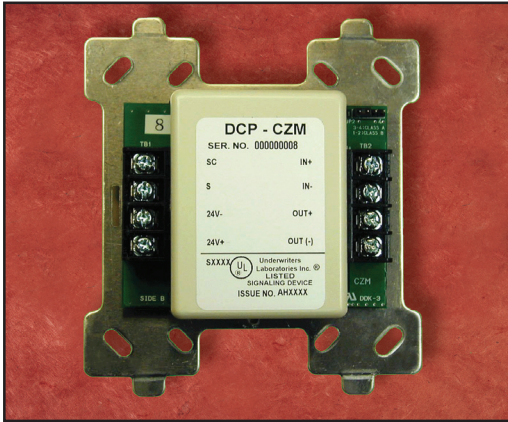


Back side of a CZM

LIST OF COMPATIBLE DEVICES

Detector Model	Detector Identifier	Detector Type	Base Model	Base Identifier	Max Detectors
SLK-24F	HD-3	Photoelectric	HSB-224	HB-53	25
SIH-24F	HD-3	Ionization	HSB-224	HB-53	25
SLR-24H	HD-3	Photoelectric w/heat	NS4-224, NS6-224	HB-5	25
SLR-24V	HD-3	Photoelectric	NS4-224, NS6-224	HB-5	25
SLR-835/-835W	HD-3	Photoelectric (8-35V)	NS4-224, NS6-224 NS4-224W, NS6-224W	HB-5	18
SLR-835H/-835HW	HD-5	Photoelectric (8-35V) w/thermal	NS4-224, NS6-224 NS4-224W, NS6-224W	HB-5	18
SLR-835B-2/-2W	HD-6	Photoelectric (8-35V) (baseless)	N/A	N/A	18
SLR-835BH-2/-2W	HD-6	Photoelectric (8-35V) w/thermal (baseless)	N/A	N/A	18
SIJ-24	HD-3	Ionization	NS4-224, NS6-224	HB-5	25
DCD-135/-190	HD-3	Heat Fixed Temp/Rate of Rise	NS4-224, NS6-224	HB-5	25
DFE-135/-190	N/A	Heat Fixed Temp	HSC-224L	HB-62	25
SLV-24/-24N/-24V	HD-3	Photoelectric	NS4-224, NS6-224 NS4-224W, NS6-224W	HB-5	25

NFPA CLASS A WIRING DIAGRAM

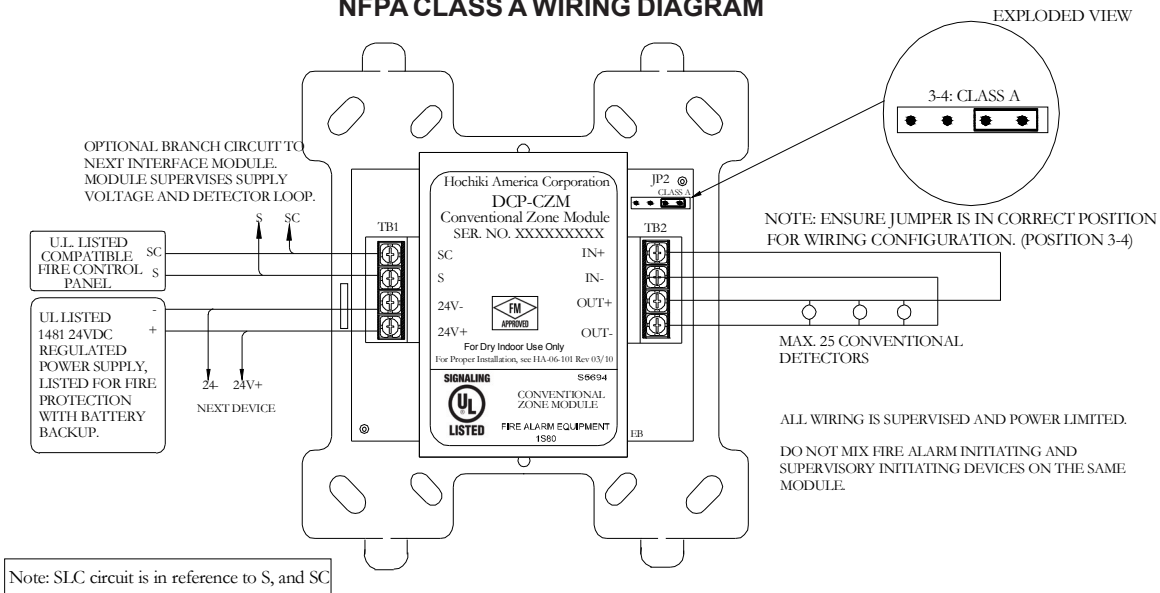

NFPA CLASS B WIRING DIAGRAM

